

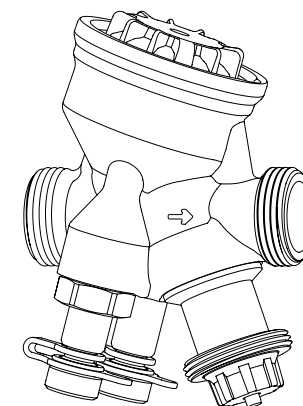
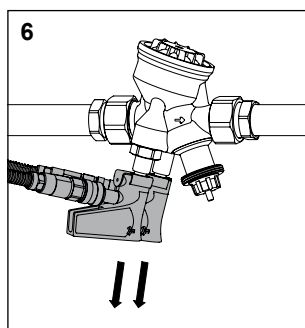
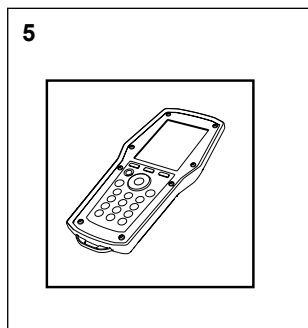
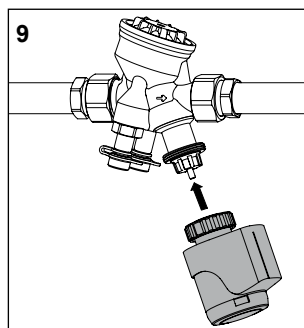
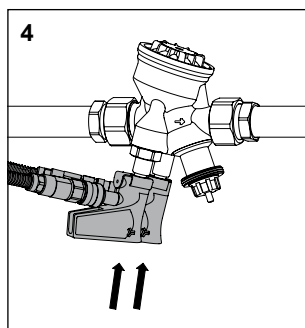
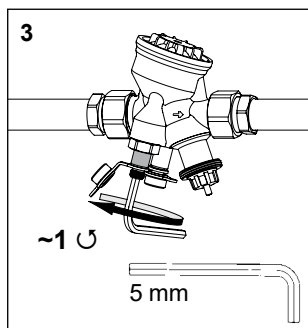
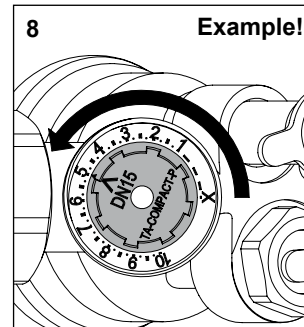
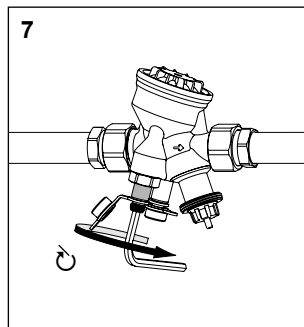


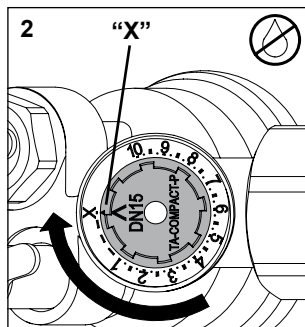

ΔH

310 700-01
02.2021

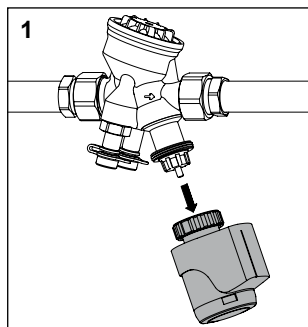

*We reserve the right to introduce technical alterations
without previous notice.*

-10°C – +90°C (+14°F – +194°F)

PN 16 (230 psi)

$\Delta pV_{\max}$: 400 kPa = 4 bar (58 psi)

$\Delta pV_{\min}$:

DN 10-20: 15 kPa = 0,15 bar (size 3/8" - 3/4": 2.2 psi)

DN 25-32: 23 kPa = 0,23 bar (size 1" - 1 1/4": 3.3 psi)

Pos	$q_{\max}$ [l/h]					
	DN 10	DN 15	DN 15 LF	DN 20	DN 25	DN 32
1	21,5	88,0	44,0	210	370	800
2	39,5	150	71,0	335	610	1220
3	54,0	200	97,0	460	830	1620
4	68,5	248	123	575	1050	2060
5	80,0	295	148	680	1270	2450
6	91,0	340	170	780	1490	2790
7	99,0	380	190	890	1720	3080
8	107	420	210	990	1870	3350
9	113	450	227	1080	2050	3550
10	120	470	245	1150	2150	3700

Pos	$q_{\max}$ [gpm]					
	3/8"	1/2"	1/2" LF	3/4"	1"	1 1/4"
1	0.09	0.39	0.19	0.92	1.63	3.52
2	0.17	0.66	0.31	1.47	2.68	5.37
3	0.24	0.88	0.43	2.02	3.65	7.13
4	0.30	1.09	0.54	2.53	4.62	9.06
5	0.35	1.30	0.65	2.99	5.59	10.8
6	0.40	1.50	0.75	3.43	6.56	12.3
7	0.44	1.67	0.84	3.92	7.57	13.6
8	0.47	1.85	0.92	4.36	8.23	14.7
9	0.50	1.98	1.00	4.75	9.02	15.6
10	0.53	2.07	1.08	5.06	9.46	16.3

$q_{\max}$ =

EN l/h (gpm) at each setting and fully open valve plug.
 DE l/h bei der jeweiligen Einstellung und voll geöffnetem Regelkegel.
 FR l/h à chaque réglage et vanne complètement ouverte.
 NL l/h van elke instelstand en volledig geopende afsluiterkegel.
 ES l/h para cada ajuste, estando el obturador en la posición totalmente abierta.
 PT l/h para cada ajuste e válvula totalmente aberta.
 IT l/h per ciascuna impostazione e con apertura totale della valvola.
 RU л/ч для каждой настройки и при полностью поднятом штоке клапана.
 HU l/h maximális térfogatáram az egyes előbeállításoknál, a szeleptányér teljes nyitásánál.
 PL l/h dla każdej nastawy przy w pełni otwartym grzybkowi zaworu.
 CS l/h pro každé nastavení při zcela otevřeném regulačním kuželce.
 SK l/hod pri danom nastavení a plne otvorenej regulačnej kúželke.
 SL l/h pri vsaki nastavitvi in popolnoma odprtem vretenu.
 RO l/h pentru fiecare poziție de reglare și vana complet deschisă.
 BG l/h за всяка настройка и при напълно отворен вентил.
 HR l/h za svaku prednamještenu poziciju i potpuno otvorenom ventilu.
 BiH l/h za svaku prednamještenu poziciju i potpuno otvorenom ventilu.
 SR l/h za svaku poziciju predpodešavanja i potpuno otvorenom ventilu.
 ET konkreetsele eelseadearvule vastav täiesti avatud ventili vooluhulk l/h.
 LV l/h katram priekšiestatījumam un pie pilnībā atvērta vārsta.
 LT l/h prie kiekvieno nustatymo ir pilnai atidaryto vožtuvo.
 TR tüm önayar değerlerinde ve tam açık vana için l/h.
 ZH l/h 在每个设定值且阀芯全开时。
 SV l/h vid respektive inställning och fullt öppna ventilkägla.
 NO l/h ved angitt innstilling og helt åpen ventilkjegle.
 FI l/h kyseisellä esiasäätöarvolla venttiilikara täysin auki.
 DA l/h ved respektiv indstilling og fuldt åben reguleringskegle.

